



**FACULTY OF ENGINEERING
CHULALONGKORN UNIVERSITY
FIRE SAFETY RESEARCH CENTER**



- TYPE OF TEST** : DETERMINATION OF THE FIRE RESISTANCE OF NON-LOADBEARING ELEMENTS OF CONSTRUCTION
- TEST SPECIMEN** : **STEEL FIREPROOF DOOR (TRADEMARK: SPR TYPE: SFD11)**
 The specimen is a doorset consisting of double-sided steel door leaves with steel door frame. The dimensions of the door leaves are (900 mm + 500 mm) x 2000 mm x 45 mm. The specimen was mounted in a 15 cm thick reinforced concrete wall, which was installed on the 3 m x 3 m testing frame. Each door leaf consisted of 1.6-mm thick cold rolled steel panels and rockwool blankets with a density of 110 kg/m³ in between. The door leaves were fixed with the door frame by a heavy duty mortise lock, 2 flush bolts and 6 stainless hinges. The details of the specimen are shown in Appendix C. The specimen was provided and installed by the client.
- CLIENT** : **SUPA RICH CO., LTD.**
 27, Soi Ramintra 48, Ramintra Road
 Khannayao, Bangkok 10230, Thailand
- DATE OF TEST** : August 1, 2012
- TEST MACHINE** : Large-scale vertical furnace (Fire Tester III) at the Fire Safety Research Center (FSRC), Department of Civil Engineering, Chulalongkorn University (Thailand). The furnace is capable of producing a standard temperature-time relationship according to BS 476 Part 20: 1987.
- TEST METHOD** : The testing procedures follow the British Standard BS 476: Fire tests on building materials and structures
BS 476 Part 20: 1987: Method for determination of the fire resistance of elements of construction (general principles)
BS 476 Part 22: 1987: Methods for determination of the fire resistance of non-loadbearing elements of construction Section 6: Determination of the fire resistance of fully insulated doorsets and shutter assemblies.
- TEST RESULTS** : The non-loadbearing element of construction described above has the fire resistance of each criterion for the period stated:
 (The test results are good only for the specimen tested.)

Criteria	Fire Resistance (hr:min)	Remarks
Insulation	0:13	The average temperature of the unexposed face of the specimen exceeded 140°C above its initial value of 38°C.
Integrity	2:05	The specimen had a passage of flame or gases hot enough to ignite the cotton pad.

Date: August 8, 2012

Tested by: 
 (Assistant Prof. Dr. Boonchai Sangpetngam)


 (Associate Prof. Dr. Thanyawat Pothisiri)


.....
 (Associate Prof. Dr. Tirawat Boonyatee)
 On Behalf of Head of Civil Engineering Department



FACULTY OF ENGINEERING
CHULALONGKORN UNIVERSITY
FIRE SAFETY RESEARCH CENTER



FURNACE TEMPERATURE

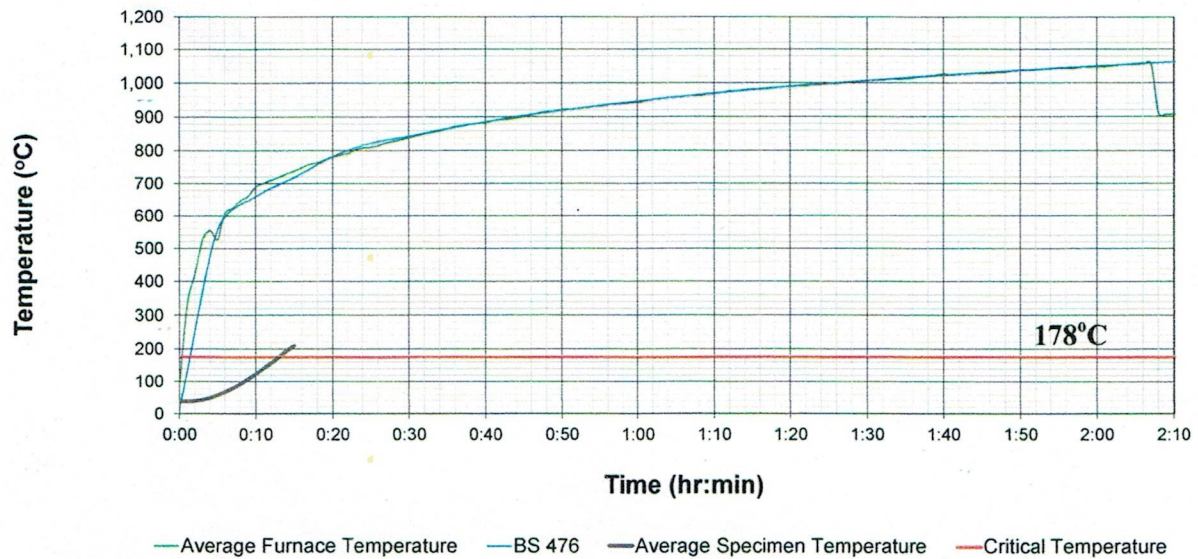


(Mr. Nattawut Hemathulin)
Authorized Testing Officer