



**LABORATORY REPORT
ON
AIRBORNE SOUND TRANSMISSION-LOSS MEASUREMENTS
OF
THE SAC 01 C42 DOOR SET
FOR
SUPA RICH CO., LTD.
THAILAND.**

**LABORATORY REPORT
ON
AIRBORNE SOUND TRANSMISSION-LOSS MEASUREMENTS
OF
THE SAC 01 C42 DOOR SET
FOR
SUPA RICH CO., LTD.
THAILAND.**



1. Subject:

Laboratory measurement of the airborne sound transmission loss (TL) of the Acoustic wooden door set model “*SAC 01 C42*” submitted by SUPA RICH Co., Ltd. on 16 November 2021.

2. Client:

SUPA RICH Co., Ltd.
27 Ramintra Soi 48, Ramintra Road,
Ramintra, Khannayao,
Bangkok 10230
Thailand.

3. Description of the Specimen:

The test sample *SAC 01 C42* is a steel-frame door set. The door surface and door frame are made of 1.6 mm thick electro galvanized steel. The internal gap is filled with Rockwool, density of 100 kg/m³ as shown in Figure 2. The door set dimension is 1010 mm x 2110 mm x 63.5 mm. The fully operable door set was installed to the 3.04 m x 2.44 m filler wall with STC = 57

The specimens were installed between two reverberation chambers, as illustrated in Figure 3.

4. Test Date:

16 November 2021.

5. Test Method:

To determine the airborne sound transmission loss (TL), the specimen was installed between two reverberation chambers (see Figure 3). The space- and time-averaged sound pressure levels in the two rooms are determined. In addition, with the test specimen in place, the sound absorption in the receiving room is determined. The sound pressure levels in the two rooms, the sound absorption in the receiving room and the area of the specimen are used to calculate transmission loss (TL) value. And the Sound transmission class (STC) is determined.

6. Measurement Facilities:

The measurement was performed in a double-reverberation chamber, with a background noise less than 30 dBA, at the Acoustics Laboratory, Department of Physics, Faculty of Science, Chulalongkorn University, Bangkok, Thailand.

The instruments used for the measurements are as follow:

- a) Random-field Condenser Microphones (G.R.A.S. model 40AR).
- b) Microphone Pre-amplifier (01dB model Pre 21).
- c) Computer-based Acoustics Analyzer (01dB model Symphonies).
- d) Building Acoustics Software (01dB Model dBBATI).
- e) Sound level calibrator (01dB Cal21).
- f) Power amplifier (QSC model PLX1804).
- g) Loudspeaker Unit (Brüel & Kjær model 4224).



7. Measurement Procedures:

Before the transmission-loss measurement, the microphone calibration was done and the background noise was measured. Then, the pink noise was sent to the loudspeaker unit, which placed in the source room. There are two microphones used in this measurement. One was installed in the source room to record the incident sound pressure level on the specimen before transmit through the material. Another microphone was placed in the receiving room to measure the transmitted sound pressure level and the reverberation time of the receiving room.

All spectra were recorded and by cause 7.3.1 of the ASTM E 90-02 the transmission loss (TL) values were calculated at each frequency in the 1/3-octave band. The center frequencies in this measurement are at 125Hz, 160Hz, 200Hz, 250Hz, 315Hz, 400Hz, 500Hz, 630Hz, 800Hz, 1kHz, 1.25kHz, 1.6kHz, 2kHz, 2.5kHz, 3.15kHz and 4kHz respectively.

Finally, the single value rating, Sound Transmission Class (STC) according to ASTM E 413 was calculated from the sound transmission loss.

8. Result:

The airborne sound transmission-loss (TL) of the test sample for each individual 1/3 octave band center frequency and the STC rating number of the test wall were tabulated in **Table 1**. The graphical representation of the values in the table 1 was shown in **figure 1**.

However, these TL-values and the STC rating in this measurement are valid only in this test condition. Thus, the internal structure of the wall, the installation and the size of the specimen can give the influences to the transmission-loss measurements.

9. This report is issued under the following conditions:

This report applies to the sample of the specific product given at the time of its testing. The results are not used to indicate or imply that they are applicable to other similar items. In addition, such results must not be used to indicate or imply that Chulalongkorn University approves, recommends or endorses the manufacturer, supplier or user of such product, or that Chulalongkorn University in any way “guarantees” the later performance of the product.

The sample/s mentioned in this report is/are submitted/supplied/manufactured by the Client. Chulalongkorn University therefore assumes no responsibility for the accuracy of information on the brand name, model number, origin of manufacture, consignment or any information supplied.

Nothing in this report shall be interpreted to mean that Chulalongkorn University has verified or ascertained any endorsement or marks from any other testing authority or bodies that may be found on that sample.

This report shall not be reproduced wholly or in parts and no reference shall be made by the Client to Chulalongkorn University or to the report or results furnished by Chulalongkorn University in any advertisements or sales promotion.



Table 1. The airborne sound transmission-loss (TL) for each individual 1/3 octave band center frequency and STC rating of the *SAC 01 C42* test sample.

Test panel: *SAC 01 C42* door set.

Client: SUPA RICH Co., Ltd.

Test sample size: 1010mm. x 2110mm. x 63.5mm.

Date of test: 16 November 2021.

Temperature: 27°c

Relative humidity: 60%

Frequency (Hz)	TL (dB)
125	24
160	32
200	40
250	42
315	40
400	43
500	44
630	45
800	44
1000	44
1250	44
1600	39
2000	38
2500	40
3150	44
4000	45

STC	42
Maximum Deficiency	8 dB
Sum of Deficiency	29 dB



Figure 1. The airborne sound transmission-loss (TL) and the STC rating of the test sample.

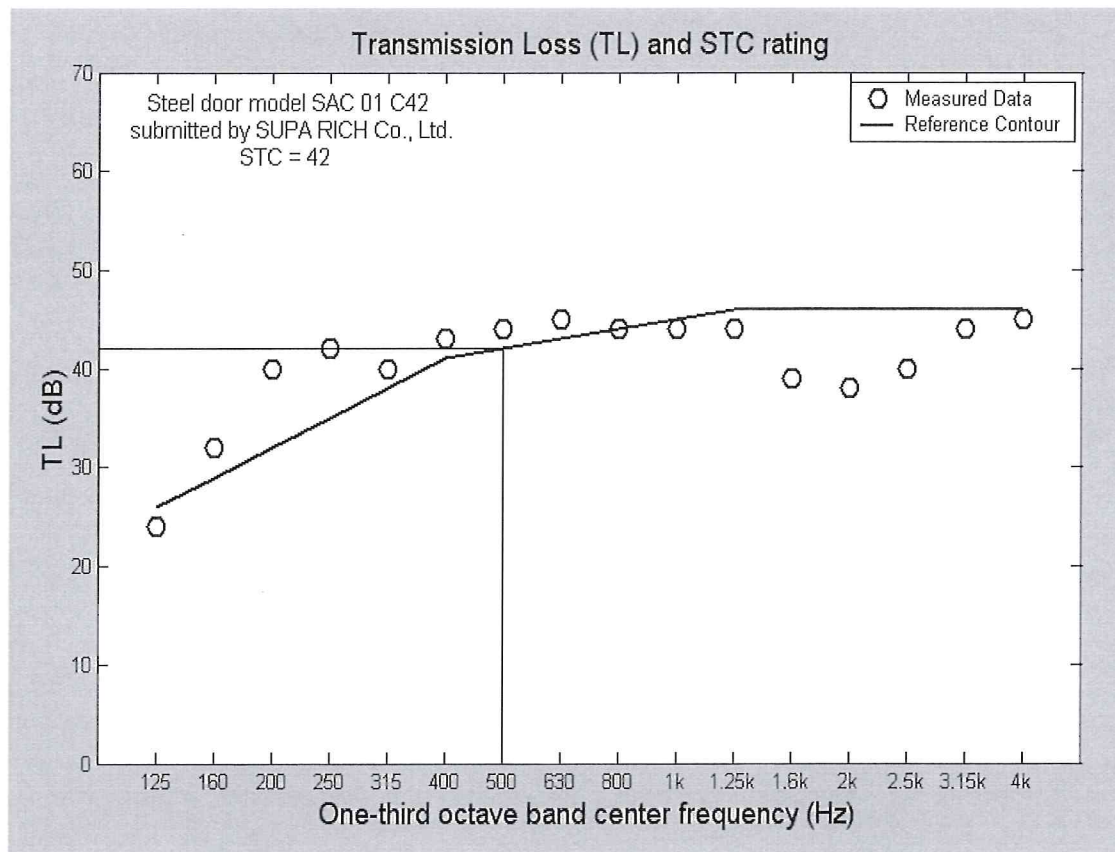


Figure 3. Schematic drawing of the measurement set-up in a double-reverberation chamber.

